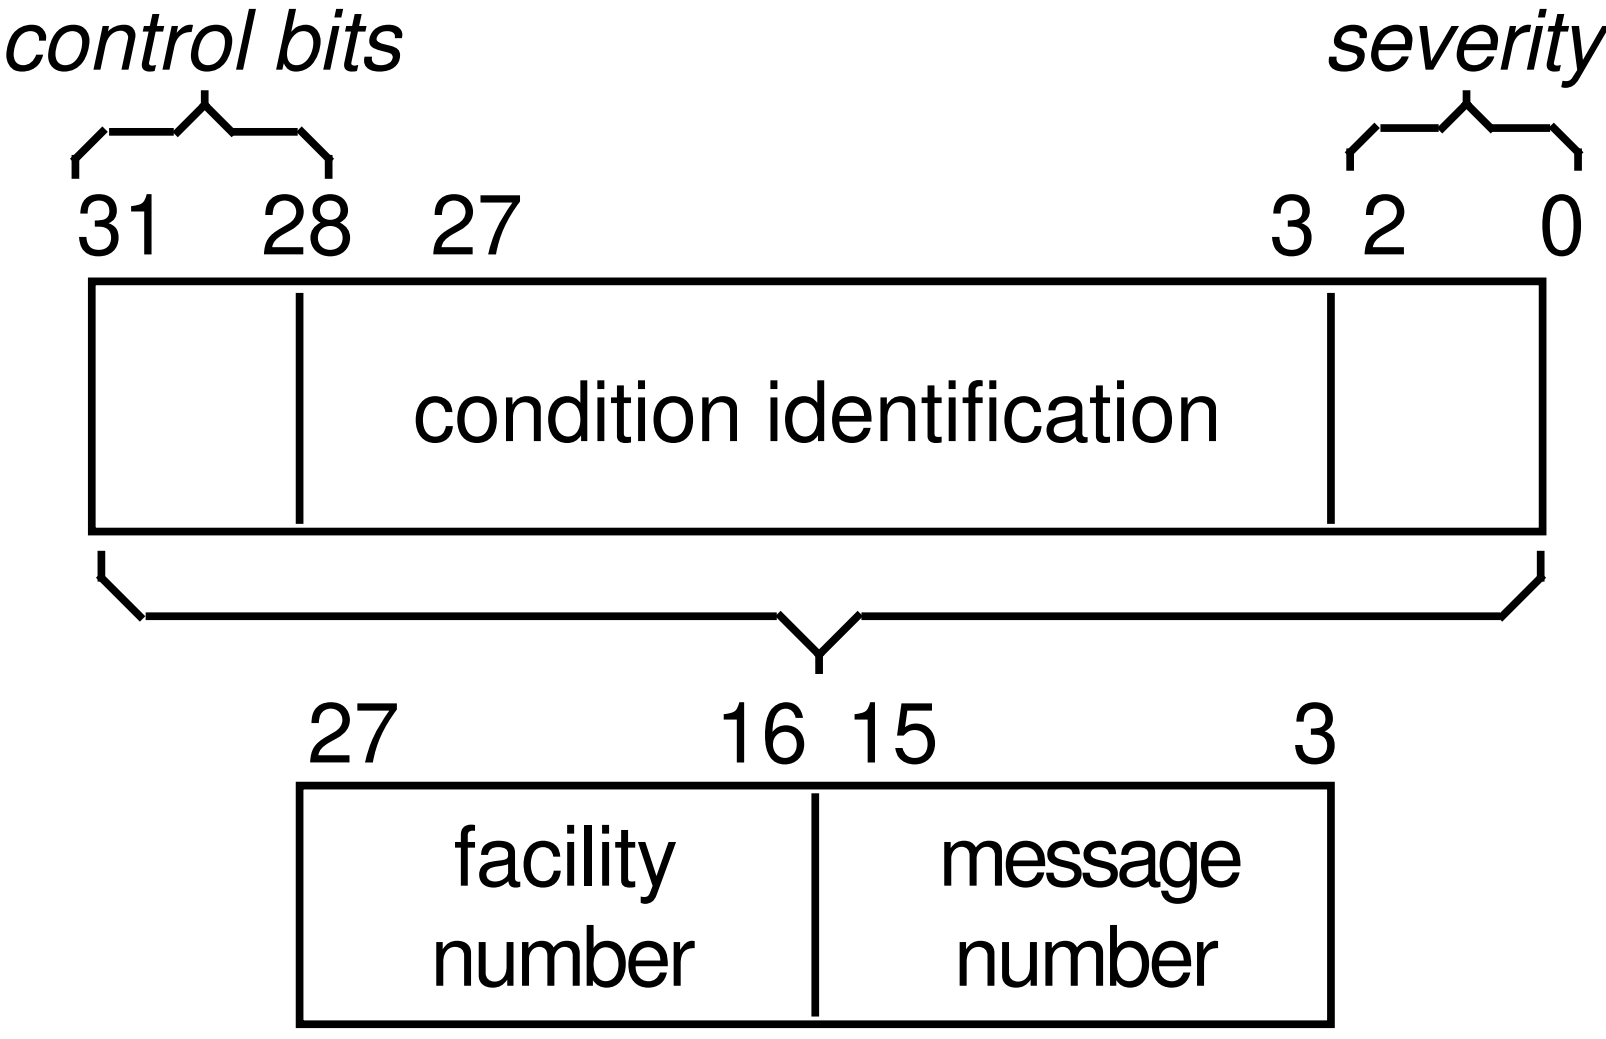
control bits
severity
31
28
27
3
2
0
condition identification
27
16
15
3
facility number
message number

ZK–0283–GE